


A-98 450-116 144-213
UNASSIGNED UNITS 577.062
M-1 #1 8/1/79

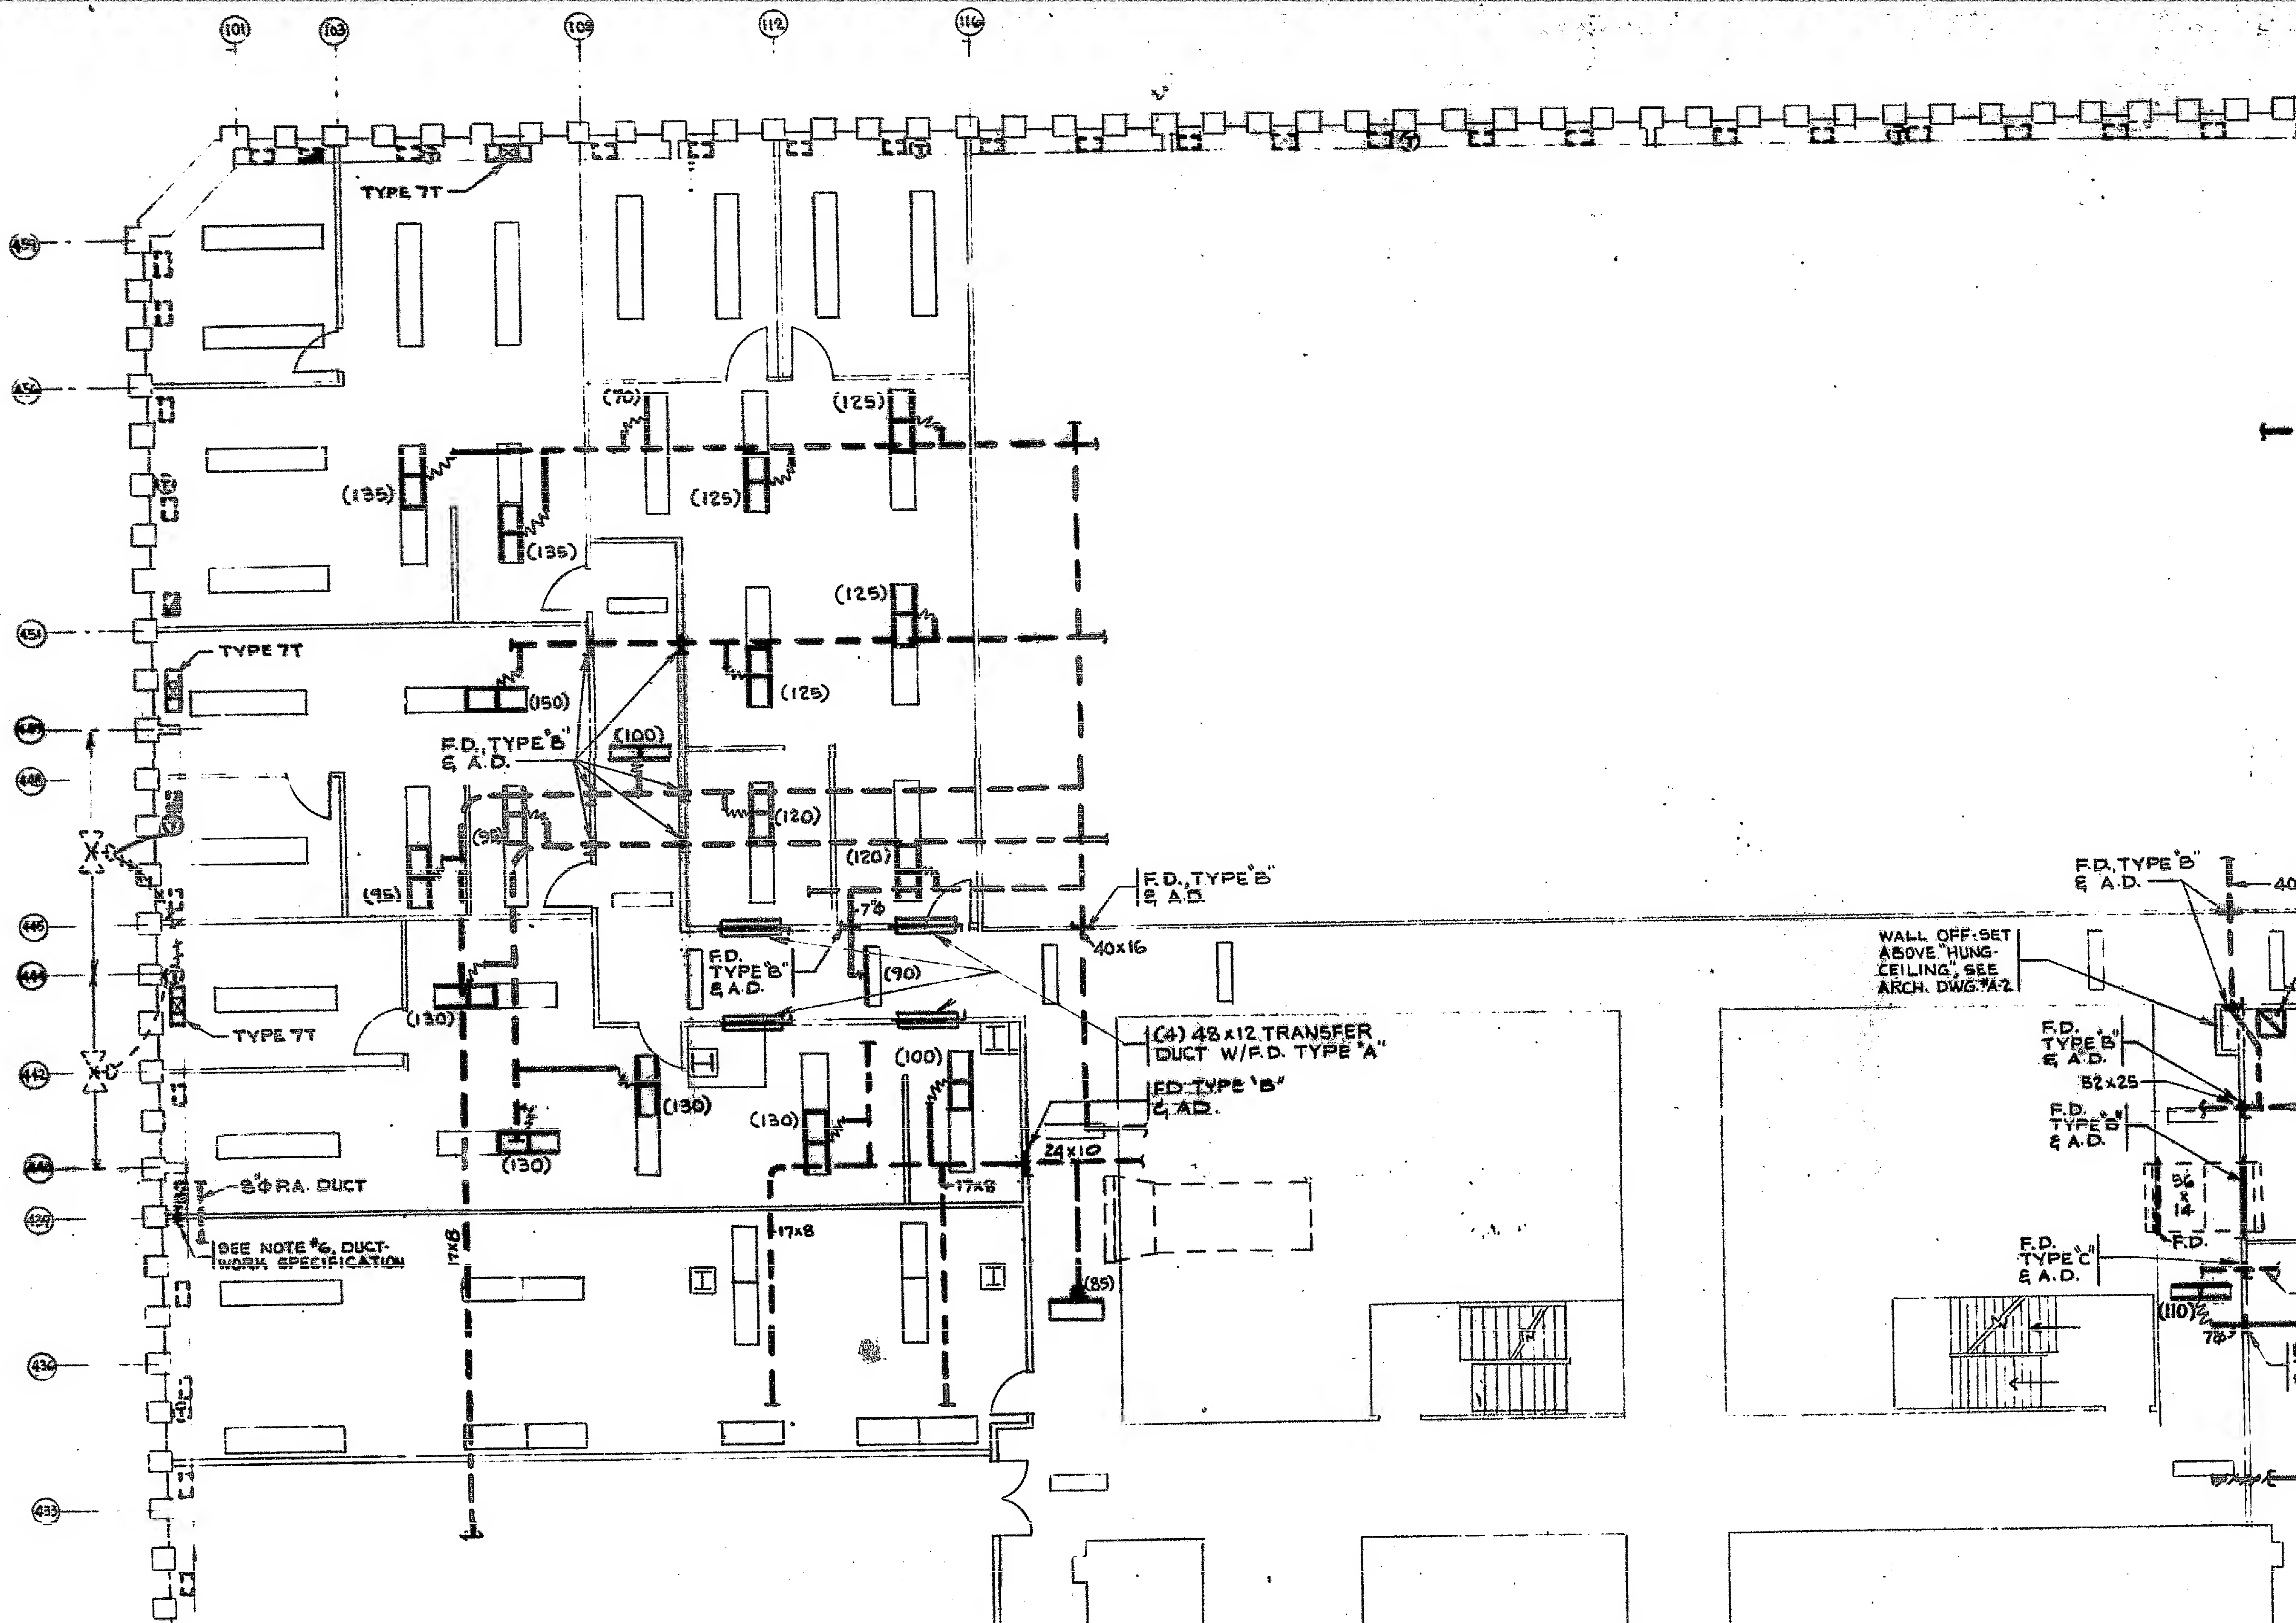

GENERAL NOTES

1. ALL FINGER DUCTS & FLEXIBLE CONNECTIONS ARE 7"Ø REGARDLESS OF CFM.
2. SEE DWG. #M-3 FOR FIRE DAMPER & TRANSFER DUCT INSTALLATION DETAILS.
3. SEE DWG. #M-2 FOR INDUCTION UNIT INSTALLATION DETAIL, SCHEDULE, LEGEND & SPECIFICATIONS.

DESIGNED R.D.B. DRAWN	REVISIONS						NO.	DATE	APPD.	DESCRIPTION	NO.	DATE	APPD.	DESCRIPTION	DATE
	NO.	DATE	APPD.	DESCRIPTION	NO.	DATE									
	1	5-7-79		GENERAL REVISIONS											
CHECKED															
IN CHARGE															

[Signature]
CHIEF ENGINEER

[Signature]
CHIEF MECHANICAL ENGINEER

[Signature]
ENGINEER OF DESIGN
AIR PORTS & WTC

JULY 6, 1979
DATE